


CONSTRUCTION TO BE DONE BY FACILITY:

- △ - 34-5/8" MINIMUM OPENING, 43-1/2" MINIMUM HALLWAY SWING CLEARANCE
- ▷ - MOUNTING SUPPORT BEHIND THE 3' X 3', 60LB TREADMILL CONTROL PANEL
- 9' MINIMUM CEILING REQUIRED ABOVE WATER TANK STORAGE ONLY
- ALL APPROVALS, PERMITS, AND AGENCY SUBMITTALS
- WET ENVIRONMENT WITH SPLASHING, DESIGN ROOM ACCORDINGLY
- AIR VENT 50CFM MINIMUM IN EACH ROOM WHERE EQUIPMENT IS LOCATED
- FLOOR BELOW TREADMILL FOOT PRINT TO BE LEVEL WITHIN .5" PER 7FT

PLUMBING TO BE DONE BY FACILITY:

- ▷ - 3" FLOOR DRAIN NEAR TREADMILL ENTRY RECOMMENDED
- ▷ - 12" X 12" RECESSED FLOOR DRAIN NEAR EQUIPMENT REQUIRED
- COLD WATER SUPPLY WITH HOSE BIB, FOR FILLING WATER STORAGE TANK
- HOT WATER WITH HOSE BIB FOR MAKEUP, TREADMILL & CARTRIDGE CLEANING

FACILITY LAYOUT:

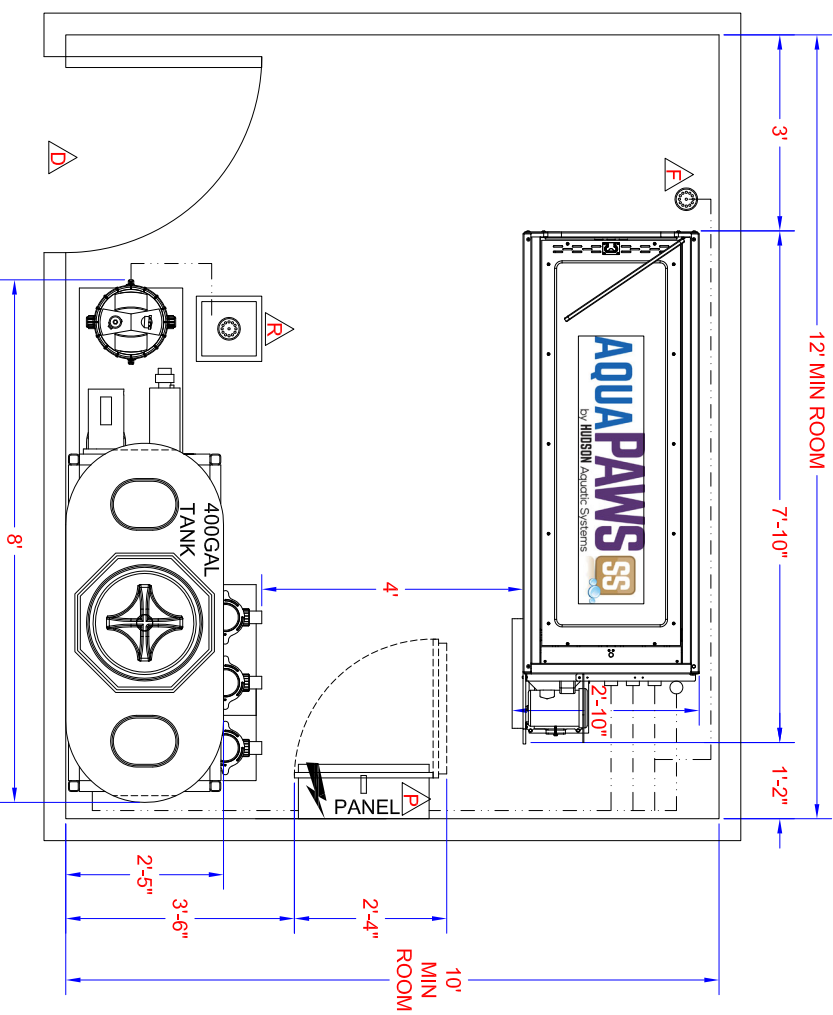

--- EXAMPLE DRAWING SHOWN, CALL ENGINEERING FOR A CUSTOM LAYOUT ---

ELECTRICAL TO BE DONE BY FACILITY:

- 230V | 1PH | 60HZ | 50AMP | 4 WIRE ELECTRICAL SUPPLY WITH A SIEMENS GFI 50-AMP SPA PANEL, **MODEL # W0408L125SPPA50 (REQUIRED)**
- SPA PANEL MUST BE WITHIN 10FT OR LESS OF TREADMILL CONTROL PANEL
- EQUIPMENT WILL RUN BELOW 230VAC, BUT SHORTENS LIFE EXPECTANCY AND VOIDS WARRANTY (AN AQUABOOST TRANSFORMER P/N0789490 RAISES 20VAC)
- MOUNT CONTROL PANEL AND CONNECT INCOMING POWER PER NEC CODE
- AFTER INSTALL BOND ALL EQUIPMENT PER NEC CODE

HUDSON SUPPLIED:

- CUSTOM DESIGNED LAYOUT DRAWING WITH THE PURCHASE OF PRODUCT
- INSTALLATION OF PURCHASED ITEMS AS PER FINAL SIGNED DRAWING
- ON SITE SERVICE TRAINING PROVIDED AFTER INSTALL
- ELECTRICAL CONNECTIONS FROM PANEL TO HEATER, PUMPS, MOTOR, & HMI
- "ASK SAW" WATER CARE SERVICE & AFTER HOURS SERVICE SUPPORT
- PROPOSED PLUMBING PATH FROM TREADMILL TO EQUIPMENT

PURCHASED ITEMS:

- 0792017 AQUAPAWSS
- 400 GALLON TANK w/RECIRC.
- 0790568 400 GALLON TANK STAND
- OPTIONS - NOT INCLUDED:**
- 0792018 AQUAPAWSS w/INCLINE
- 400 GALLON TANK w/RECIRC.
- 2182578 SIEMENS GFI 50-AMP SPA PANEL
- 0792021 4 PACK JETS
- 0790209 THERAPY BENCH
- 0790950-A UV WATER SANITIZER
- 0790364-A OZONE WATER SANITIZER
- 2810401 INSULATED 400 GAL TANK COVER
- 0790007 WATER TANK AUTO FILL VALVE
- 2810350 HAIR & DUST TREADMILL COVER
- 1520909 100FT HMI CABLE UPGRADE
- 0790200 2 SHELF EQUIPMENT STAND

WEIGHTS:

- TREADMILL WEIGHT 620 LBS
- TREADMILL w/30" WATER WEIGHT 3,446 LBS
- 400 GALLON TANK WEIGHT 200 LBS
- 400 GAL TANK & WATER WEIGHT 3,534 LBS

FLOOR LOADS:

- TREADMILL & WATER FLOOR LOAD 228 LBS PER SQ. FT.
- 400G TANK & WATER FLOOR LOAD 354 LBS PER SQ. FT.



AQUATIC SYSTEMS, LLC
1100 WOHLERT ST | ANGOLA, IN 46703
PHONE: 1-800-939-3374 | ENG EXT.: 222

THIS DRAWING AND INFORMATION CONTAINED THEREON ARE CONFIDENTIAL AND THE PROPERTY OF HUDSON AQUATIC SYSTEMS, LLC. THEY ARE NOT TO BE REPRODUCED, DISTRIBUTED, DISCLOSED OR USED FOR ANY PURPOSE WITHOUT THE EXPRESS WRITTEN CONSENT OF HUDSON AQUATIC SYSTEMS.

DRAWN BY:	SALESMAN:	REV. DATE:	DRAWING #:	FACILITY NAME:
SDS	XXXXX XXXXX	5-5-21	XX-XXXX	AQUAPAWSS SAMPLE LAYOUT DRAWING

--- FINAL DRAWING SIGN OFF ---
PRODUCT TO BE BUILT AND INSTALLED AS SHOWN:
APPROVED BY: _____
DATE: _____