


**CONSTRUCTION TO BE DONE BY FACILITY:**

- 34-5/8" MINIMUM OPENING, 43-1/2" MINIMUM HALLWAY SWING CLEARANCE
- MOUNTING SUPPORT BEHIND THE 3' X 3', 60LB TREADMILL CONTROL PANEL
- 9' MINIMUM CEILING REQUIRED ABOVE WATER TANK STORAGE ONLY
- ALL APPROVALS, PERMITS, AND AGENCY SUBMITTALS
- WET ENVIRONMENT WITH SPLASHING, DESIGN ROOM ACCORDINGLY
- AIR VENT 50CFM MINIMUM IN EACH ROOM WHERE EQUIPMENT IS LOCATED
- FLOOR BELOW TREADMILL FOOT PRINT TO BE LEVEL WITHIN .5" OVER 8FT AND IF NOT LEVEL A MINIMUM PAD OF 30-1/2" x 94" TO SUPPORT 228 LBS PER SQ. FT.

**PLUMBING TO BE DONE BY FACILITY:**

- 3" FLOOR DRAIN NEAR TREADMILL ENTRY RECOMMENDED
- 12" X 12" RECESSED FLOOR DRAIN NEAR EQUIPMENT REQUIRED
- COLD WATER SUPPLY WITH HOSE BIB, FOR FILLING WATER STORAGE TANK
- HOT WATER WITH HOSE BIB FOR MAKEUP, TREADMILL & CARTRIDGE CLEANING

**FACILITY LAYOUT:**

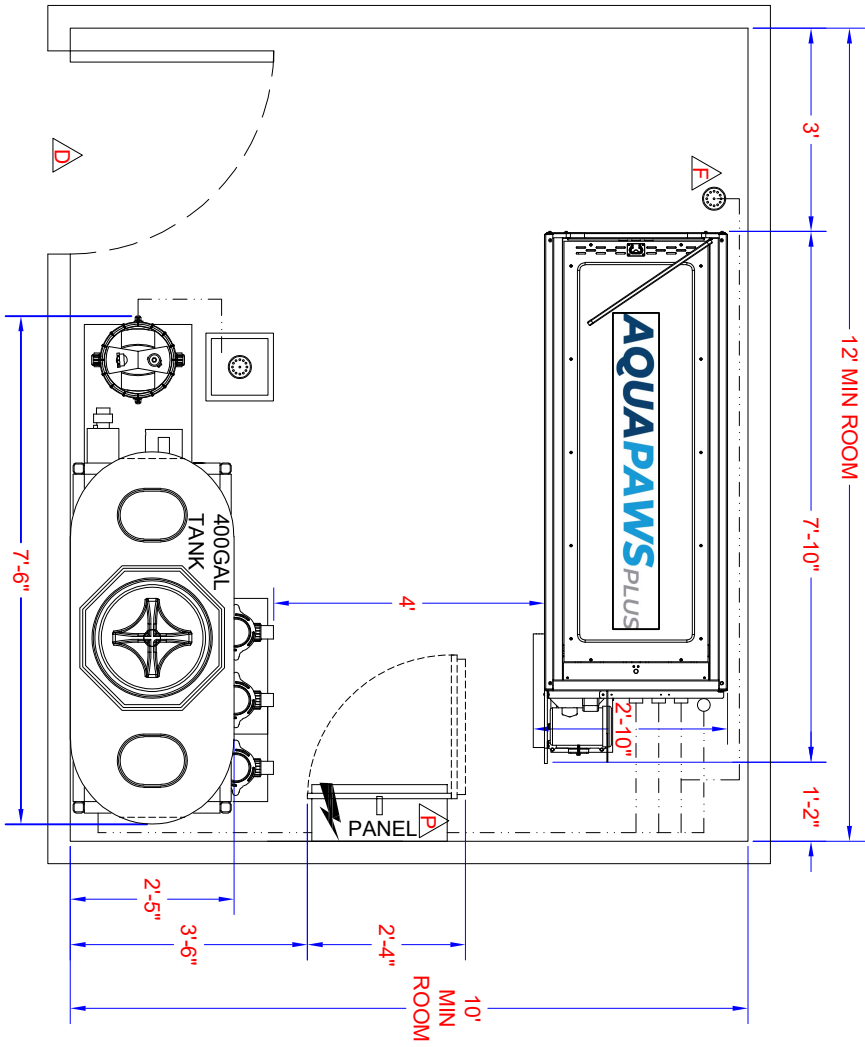

**ELECTRICAL TO BE DONE BY FACILITY:**

- 230V | 1PH | 60HZ | 50AMP | 4 WIRE ELECTRICAL SUPPLY WITH A SIEMENS GFI 50-AMP SPA PANEL, MODEL # W0408L1125SPA50 (REQUIRED)
- SPA PANEL MUST BE WITHIN 10FT OR LESS OF TREADMILL CONTROL PANEL
- EQUIPMENT WILL RUN BELOW 230VAC, BUT SHORTENS LIFE EXPECTANCY AND VOIDS WARRANTY (AN AQUABOOST TRANSFORMER P/N0789490 RAISES 20VAC)
- MOUNT CONTROL PANEL AND CONNECT INCOMING POWER PER NEC CODE
- AFTER INSTALL BOND ALL EQUIPMENT PER NEC CODE

**HUDSON SUPPLIED:**

- CUSTOM DESIGNED LAYOUT DRAWING WITH THE PURCHASE OF PRODUCT
- INSTALLATION OF PURCHASED ITEMS AS PER FINAL SIGNED DRAWING
- ON SITE IN-SERVICE TRAINING PROVIDED AFTER INSTALL
- ELECTRICAL CONNECTIONS FROM PANEL TO HEATER, PUMPS, MOTOR, & HMI
- "ASK SAM" WATER CARE SERVICE & AFTER HOURS SERVICE SUPPORT
- PROPOSED PLUMBING PATH FROM TREADMILL TO EQUIPMENT

**PURCHASED ITEMS:**

- 0792017 AQUAPAWS SS
- 400 GALLON TANK w/RECIRC.
- 0790568 400 GALLON TANK STAND

**OPTIONS - NOT INCLUDED:**

- 0792018 AQUAPAWS SS w/INCLINE
- 400 GALLON TANK w/RECIRC.
- 2182578 SIEMENS GFI 50-AMP SPA PANEL
- 0792021 4 PACK JETS
- 0790209 THERAPY BENCH

- 0790950-A UV WATER SANITIZER w/30" CORD
- 0790364-A OZONE WATER SANITIZER
- 2810401 INSULATED 400 GAL TANK COVER

- 0790007 WATER TANK AQUA-FILL VALVE
- 2810350 HAIR & DUST TREADMILL COVER
- 1520909 100FT HMI CABLE UPGRADE
- 0790200 2 SHELF EQUIPMENT STAND

- WEIGHTS:**
- TREADMILL EMPTY 620 LBS
- TREADMILL w/30" WATER 3,446 LBS
- 400 GALLON TANK EMPTY 200 LBS
- 400 GAL TANK w/WATER 3,534 LBS

- FLOOR LOADS:**
- TREADMILL w/30" WATER 228 LBS PER SQ. FT.
- 400G TANK w/WATER 354 LBS PER SQ. FT.

--- **EXAMPLE DRAWING SHOWN, CALL ENGINEERING FOR A CUSTOM LAYOUT** ---



100 WOHLETT ST | ANGOLA, IN 46703  
HOME:1-800-939-5374 | ENG EXT: 222

THIS DRAWING AND INFORMATION CONTAINED THEREON ARE CONFIDENTIAL AND THE PROPERTY OF HUDSON AQUATIC SYSTEMS, LLC. THEY ARE NOT TO BE REPRODUCED, DISTRIBUTED, DISCLOSED OR USED FOR ANY PURPOSE WITHOUT THE EXPRESS WRITTEN CONSENT OF HUDSON AQUATIC SYSTEMS.

DRAWN BY:	SALESMAN:	REV. DATE:	DRAWING #:	FACILITY NAME:
HJS	XXXXX XXXXX	4-2-24	XX-XXXX	AQUAPAWS PLUS SAMPLE (SPACE SAVER STAND) LAYOUT DRAWING
<p>APPROVED BY: _____</p> <p>DATE: _____</p> <p>--- <b>FINAL DRAWING SIGN OFF</b> ---</p> <p>PRODUCT TO BE BUILT AND INSTALLED AS SHOWN:</p>				