


**CONSTRUCTION TO BE DONE BY FACILITY:**

- ALL DOORS FROM ENTRY AND PATH OF TRAVEL TO INSTALL AREA MUST BE UNHINGED LEAVING A CLEAR UNOBSTRUCTED 34-5/8" MINIMUM OPENING & A 6" MINIMUM HALLWAY SWING CLEARANCE FOR TREADMILL AND TANK
- MOUNTING SUPPORT BEHIND THE 3' X 3', 60LB TREADMILL CONTROL PANEL
- 12" WIDE X 6" HIGH HOLE THROUGH WALL AS CLOSE TO FLOOR AS POSSIBLE
- ALL APPROVALS, PERMITS, AND AGENCY SUBMITTALS
- WET ENVIRONMENT WITH SPLASHING, DESIGN ROOM ACCORDINGLY
- AIR VENT 50CFM MINIMUM IN EACH ROOM WHERE EQUIPMENT IS LOCATED
- FLOOR BELOW TREADMILL FOOT PRINT TO BE LEVEL WITHIN .5" PER 7FT

**PLUMBING TO BE DONE BY FACILITY:**

- 3" FLOOR DRAIN NEAR TREADMILL ENTRY RECOMMENDED
- 12" X 12" RECESSED FLOOR DRAIN NEAR EQUIPMENT REQUIRED
- COLD WATER SUPPLY WITH HOSE BIB, FOR FILLING WATER STORAGE TANK
- HOT WATER WITH HOSE BIB FOR MAKEUP, TREADMILL & CARTRIDGE CLEANING

**FACILITY LAYOUT:**

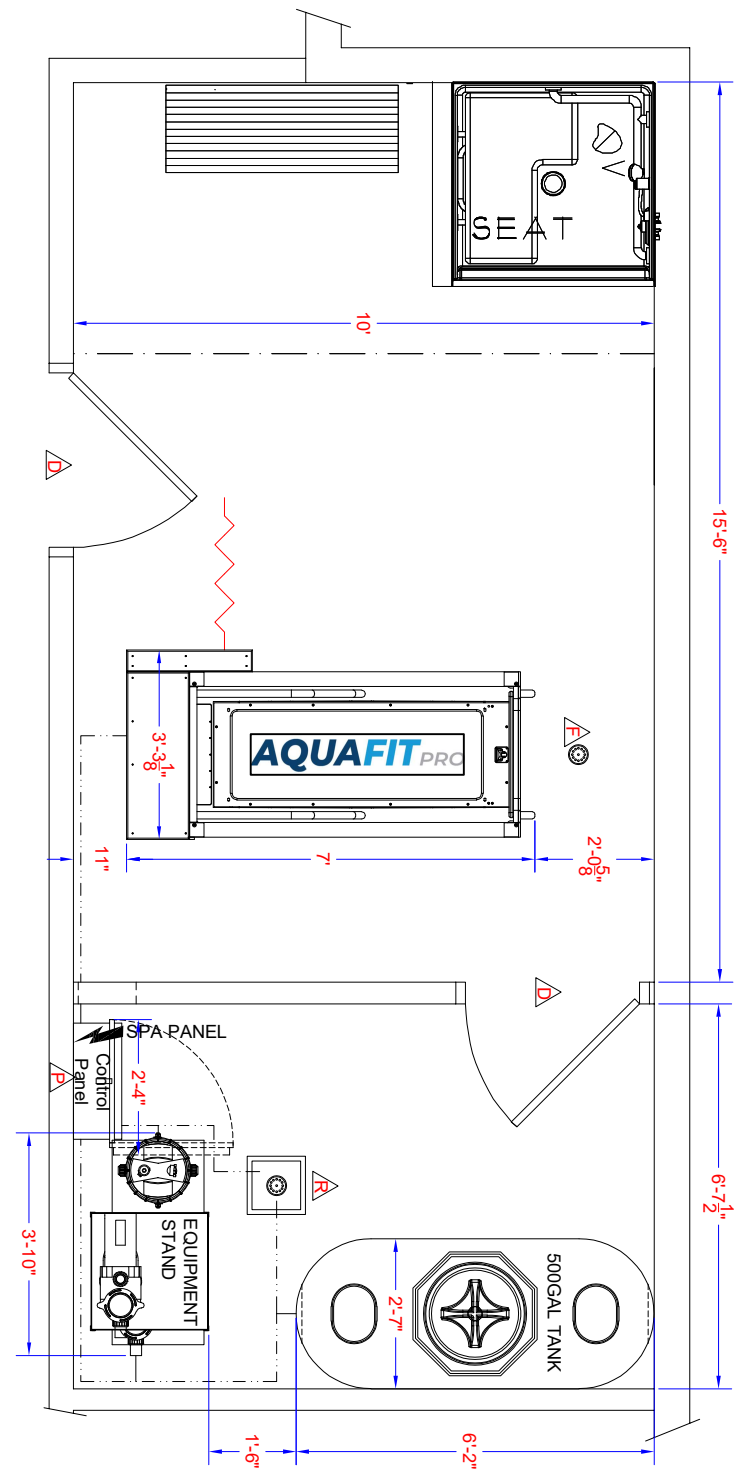

**ELECTRICAL TO BE DONE BY FACILITY:**

- 230V | 1PH | 60HZ | 50AMP | 4 WIRE ELECTRICAL SUPPLY WITH A SIEMENS GFI 50-AMP SPA PANEL, MODEL # W0408L1125SPA50 (REQUIRED)
- SPA PANEL MUST BE WITHIN 10FT OR LESS OF TREADMILL CONTROL PANEL
- EQUIPMENT WILL RUN BELOW 230VAC, BUT SHORTENS LIFE EXPECTANCY AND VOIDS WARRANTY (AN AQUABOOST TRANSFORMER P/N0789490 RAISES 20VAC)
- MOUNT CONTROL PANEL AND CONNECT INCOMING POWER PER NEC CODE
- AFTER INSTALL BOND ALL EQUIPMENT PER NEC CODE

**HUDSON SUPPLIED:**

- CUSTOM DESIGNED LAYOUT DRAWING WITH THE PURCHASE OF PRODUCT
- INSTALLATION OF PURCHASED ITEMS AS PER FINAL SIGNED DRAWING
- ON SITE IN-SERVICE TRAINING PROVIDED AFTER INSTALL
- ELECTRICAL CONNECTIONS FROM PANEL TO HEATER, PUMPS, MOTOR, & HMI
- "ASK SAM" WATER CARE SERVICE & AFTER HOURS SERVICE SUPPORT
- PROPOSED PLUMBING PATH FROM TREADMILL TO EQUIPMENT
- 3 FT DRIVE SHAFT CLEARANCE AREA FOR TREADMILL SERVICE

**SYSTEM W/WATER SOURCE:**

- 0792001 AQUAFIT W/FILL & DRAIN PUMPS
- 500 GAL TANK W/RECIRCULATION

**TREADMILL UPGRADES:**

- 0792002 RESISTANCE JETS
- 0790802 EXTERIOR HAND RAILS AT ENTRY
- 0790801 FOLD DOWN SEAT

**OPTIONS:**

- 0790200 2 SHELF EQUIPMENT STAND
- 2182578 SIEMENS GFI 50-AMP SPA PANEL
- 0790364-A OZONE WATER SANITIZER

**ACCESSORIES:**

- 2810403 INSULATED 500 GAL TANK COVER

**WEIGHTS:**

- TREADMILL EMPTY 1,250 LBS
- TREADMILL w/48" WATER 5,400 LBS
- 500 GALLON TANK EMPTY 215 LBS
- 500 GALLON TANK w/WATER 4,500 LBS

**FLOOR LOADS:**

- TREADMILL w/48" WATER 302 LBS PER SQ. FT.
- 500 GALLON TANK w/WATER 354 LBS PER SQ. FT.

--- FINAL DRAWING SIGN OFF ---  
 PRODUCT TO BE BUILT AND INSTALLED AS SHOWN:  
 APPROVED BY: \_\_\_\_\_  
 DATE: \_\_\_\_\_

--- EXAMPLE DRAWING SHOWN, CALL ENGINEERING FOR A CUSTOM LAYOUT ---

THIS DRAWING AND INFORMATION CONTAINED THEREON ARE CONFIDENTIAL AND THE PROPERTY OF HUDSON AQUATIC SYSTEMS, LLC. THEY ARE NOT TO BE REPRODUCED, DISTRIBUTED, DISCLOSED OR USED FOR ANY PURPOSE WITHOUT THE EXPRESS WRITTEN CONSENT OF HUDSON AQUATIC SYSTEMS.

DRAWN BY: HJS	SALESMAN: XXXXX XXXXX	REV. DATE: 4-2-24	DRAWING #: 83-5062	FACILITY NAME: AQUAFIT PRO w/OPTIONS & ACCESSORIES (SAMPLE LAYOUT)
------------------	--------------------------	----------------------	-----------------------	---